

TYPICAL GAS CONNECTION - TUBE HEATERS

ALTERNATE SUPPLY LOCATIONS

Certified connectors are recommended to be installed as shown, in one plane and without sharp bends, kinks or twists. The gas take off from the drop line must be parallel to the burner gas inlet connection.

If the maximum supply pressure is less than 1/2 PSIG, a second stage regulator is not required.

200,000 BTU/HR and above require a 3/4" flex connector.

* AVAILABLE AS ACCESSORIES

END VIEW

* SECOND STAGE REGULATOR WITH VENT LEAK LIMITER TO REDUCE THE SUPPLY PRESSURE BELOW 14" W.C.


* APPROVED FLEXIBLE CONNECTOR

* MANUAL GAS SHUT OFF VALVE

GAS PRESSURE = 2PSIG

GAS SUPPLY PIPING

SEDIMENT TRAP (DRIP LEG)

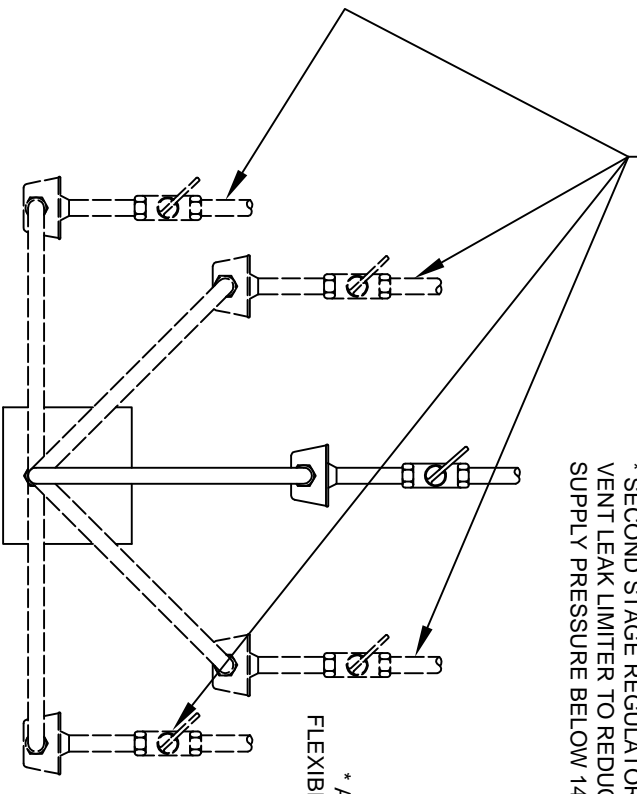

SIDE VIEW

MOVEMENT

