
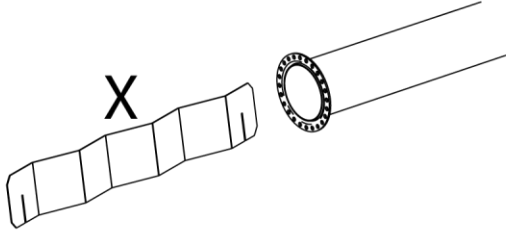
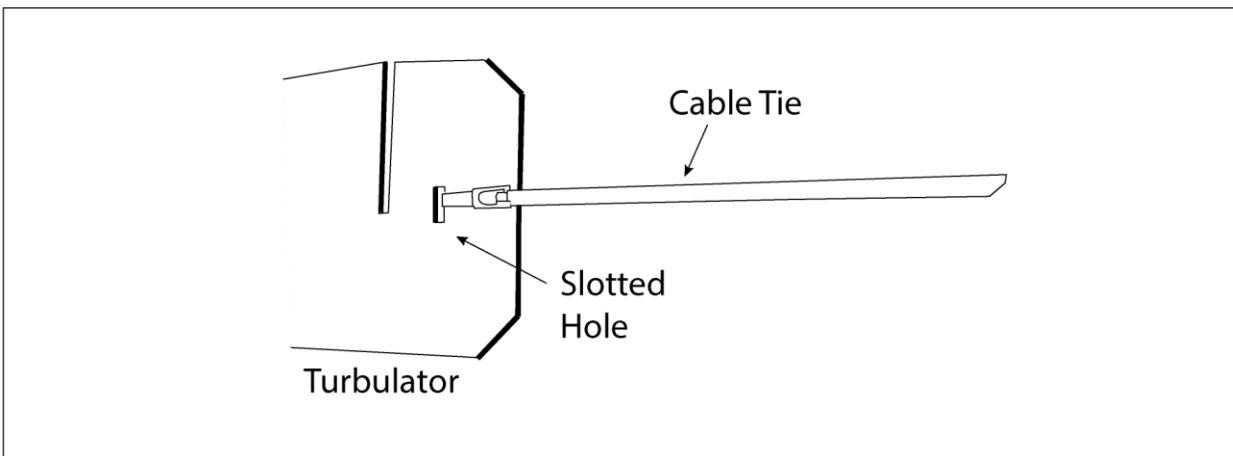


ADDENDUM


Securing the Turbulator

⚠ WARNING	
	FIRE HAZARD Turbulators must never be installed at the flange end of the tube.
	


1. Insert cable tie into slotted hole portion of turbulator and close.




2. Slide turbulator in end of tube. Refer to the I & O manuals for correct location and quantity of turbulators to be installed.

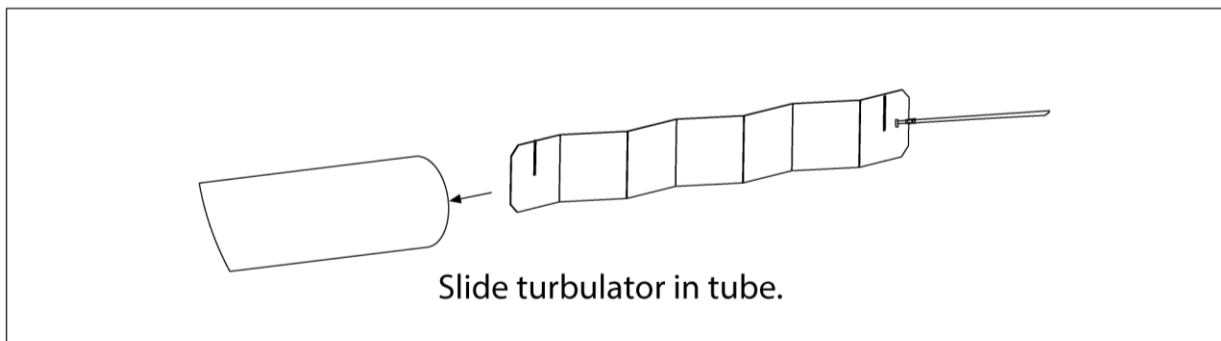


3. Fold cable tie over end of tube. Position cable tie to be visible once heater is installed.

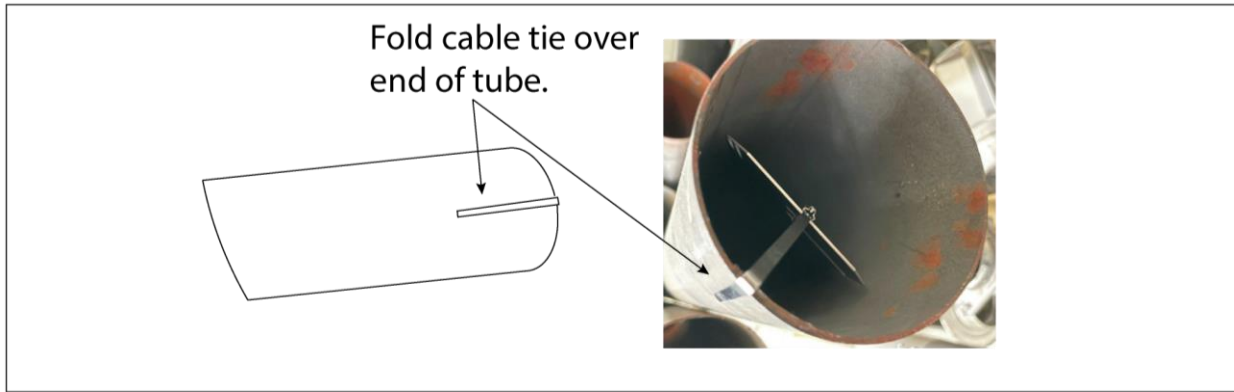


4. PBF 60,70,80 MODELS ONLY - Slide U-bend over tubes and secure with #10 x 1/2" self-drill screws.

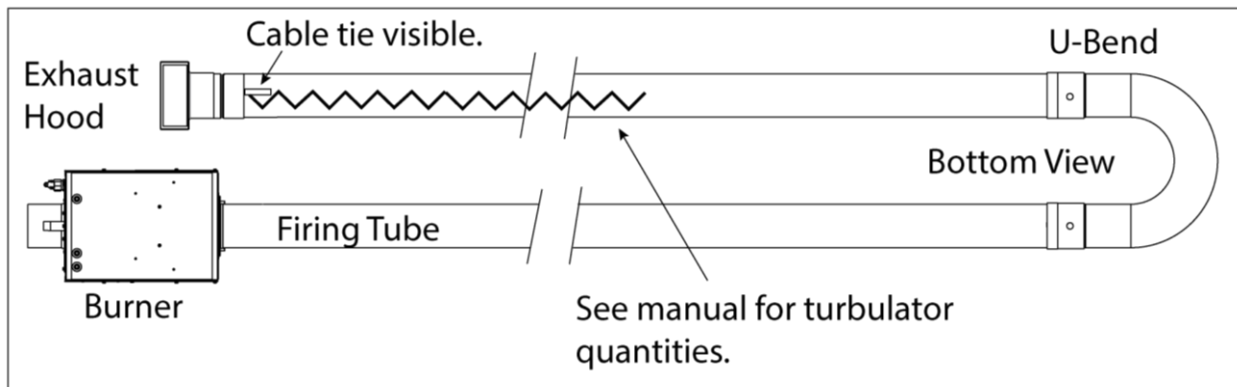

5. PBF 90 MODELS ONLY - Slide U-bend over tubes and secure with #10 x 1/2" self-drill screws.

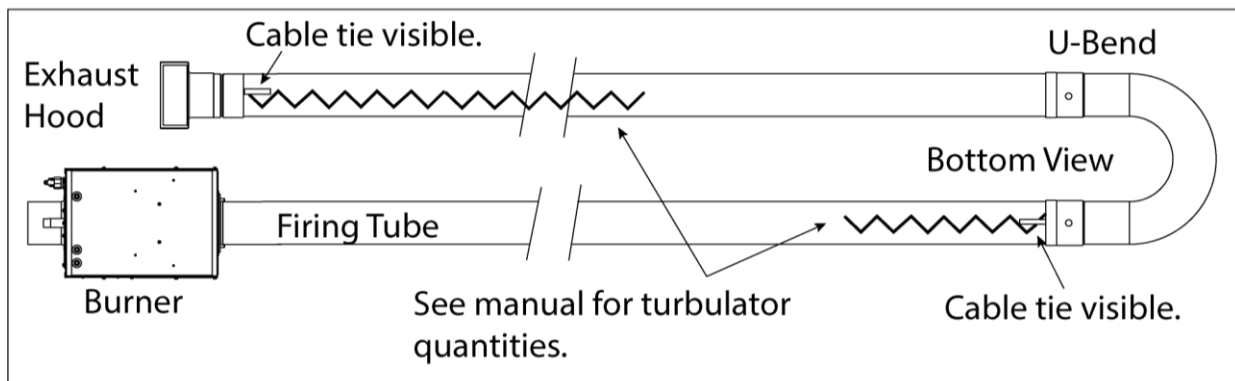


6. Fusion, PCA and Defender models.

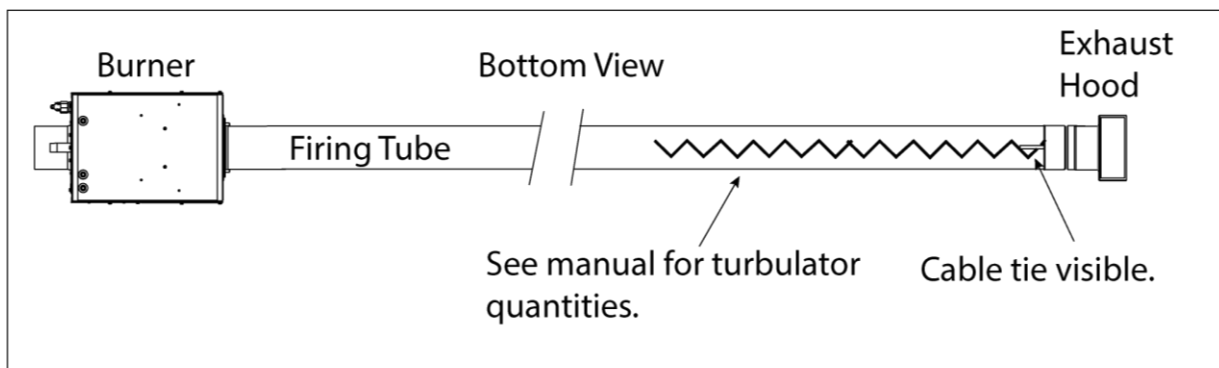


Adición


Asegurar el Turbulador

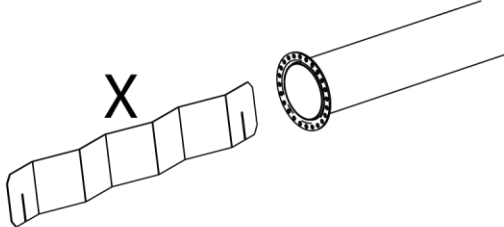⚠ ADVERTENCIA	
	PELIGRO DE INCENDIO Los turbuladores nunca deben instalarse en el lado del tubo con la brida.
	


1. Inserte la corbata del cable en la porción del orificio ranurado del turbulador y ciérrela.

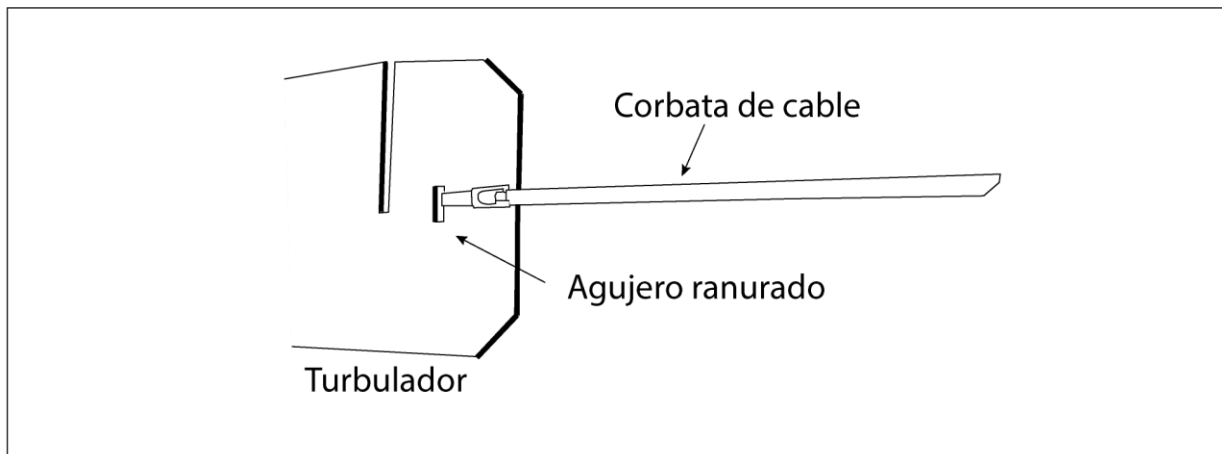


2. Deslice el turbulador al final del tubo. Consulte los manuales de I & O para conocer la ubicación y la cantidad correctas de turbuladores que se instalarán.

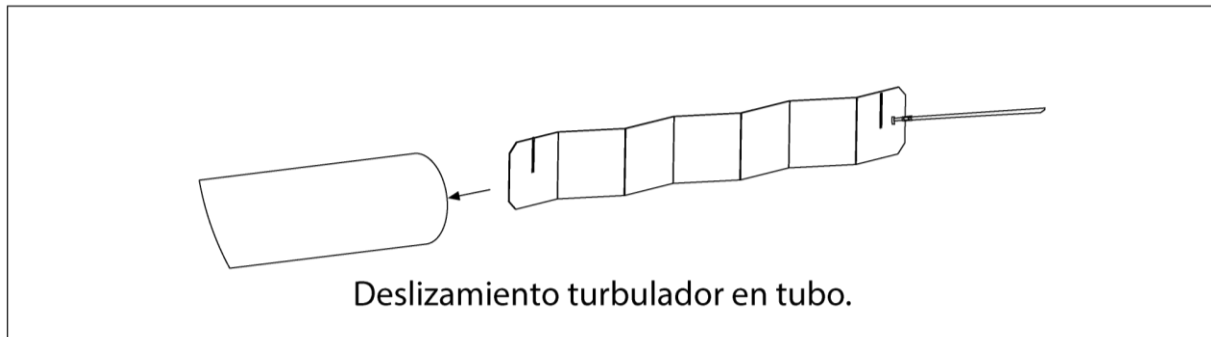


3. Doble la corbata del cable sobre el extremo del tubo. Coloque la corbata del cable para que sea visible cuando esta instalado el calentador.

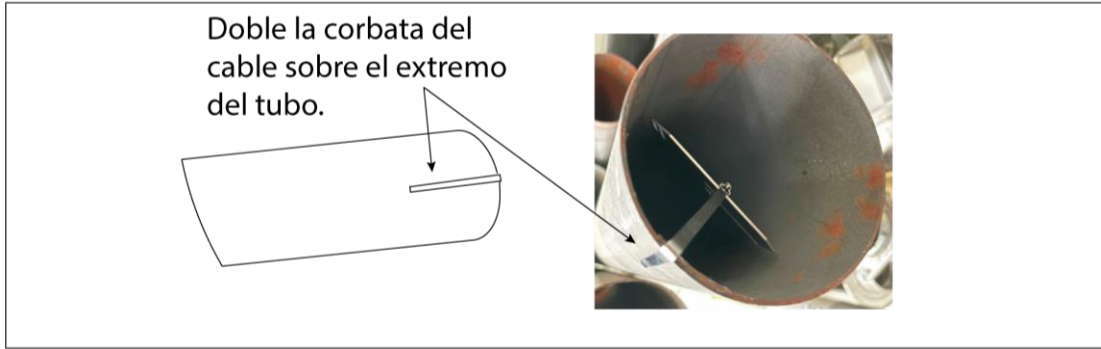

4. PBF 60,70,80 MODELOS SOLAMENTE – Deslice el tubo en U sobre los tubos y asegure con #10 x 1/2" tornillos auto-perforación.

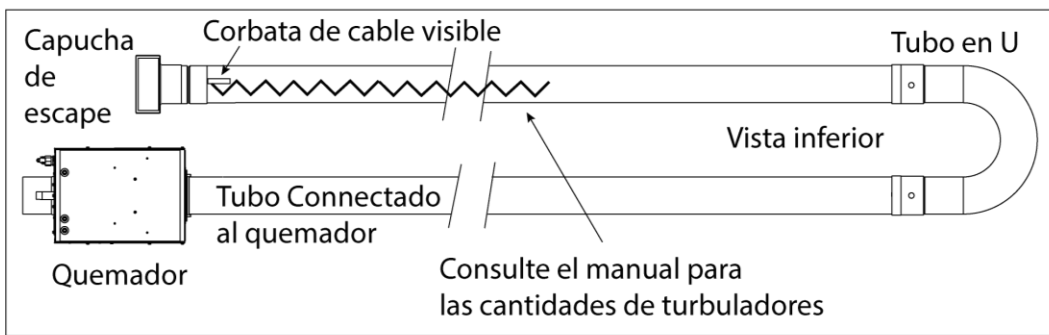

5. MODELOS PBF 90 SOLAMENTE – Deslice el tubo en U sobre los tubos y fije con #10 x 1/2" tornillos auto-perforados de 1/2".

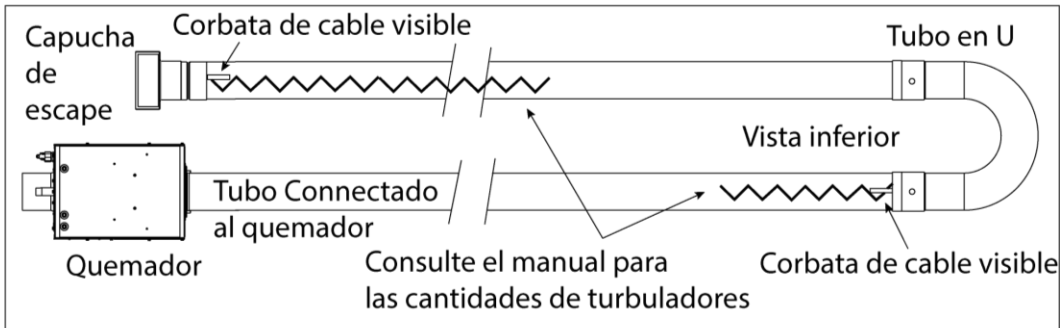

6. MODELOS Fusion, PCA y Defender.

